



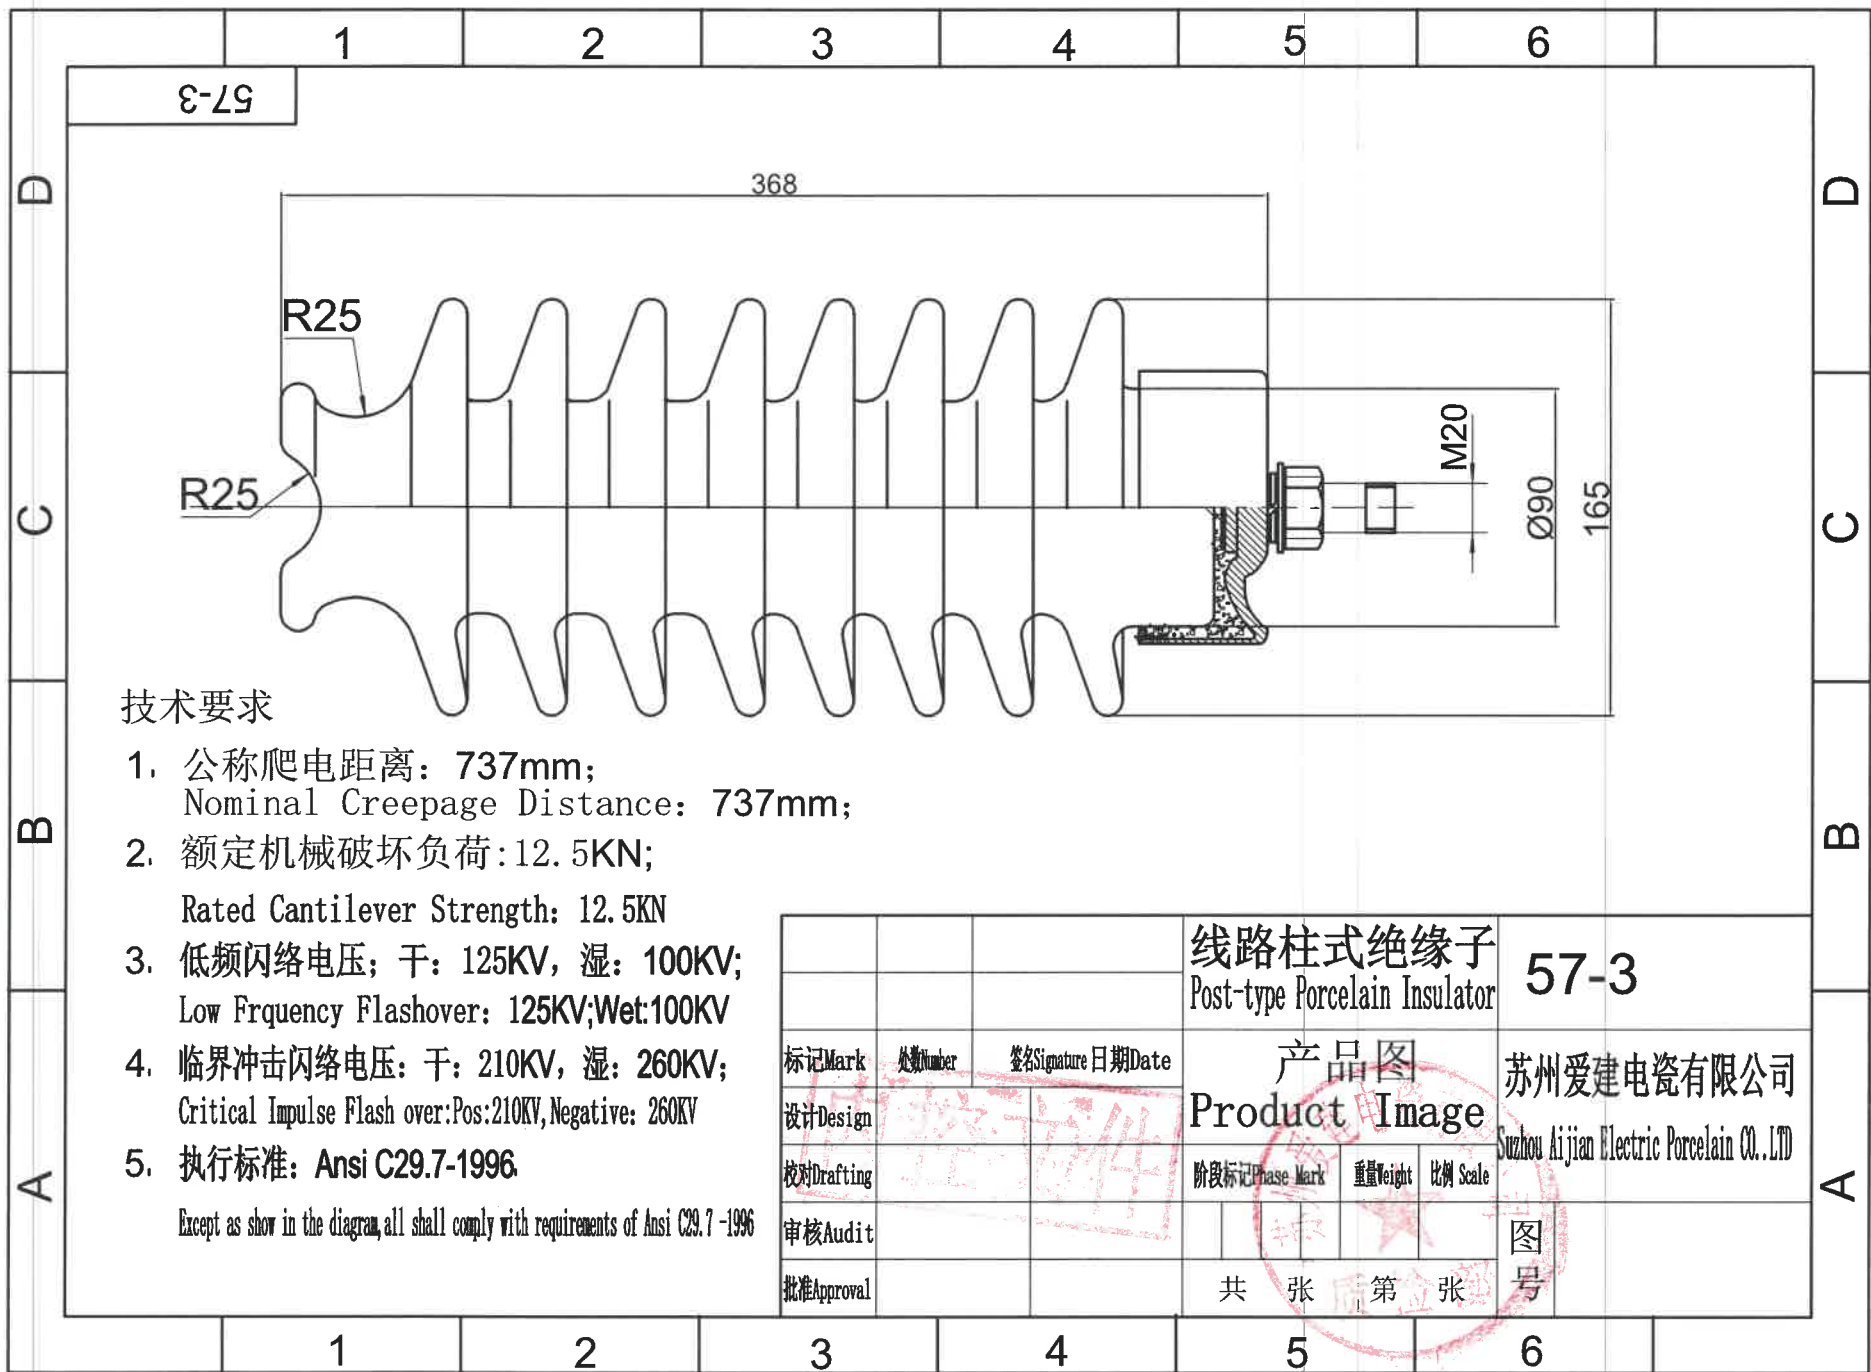

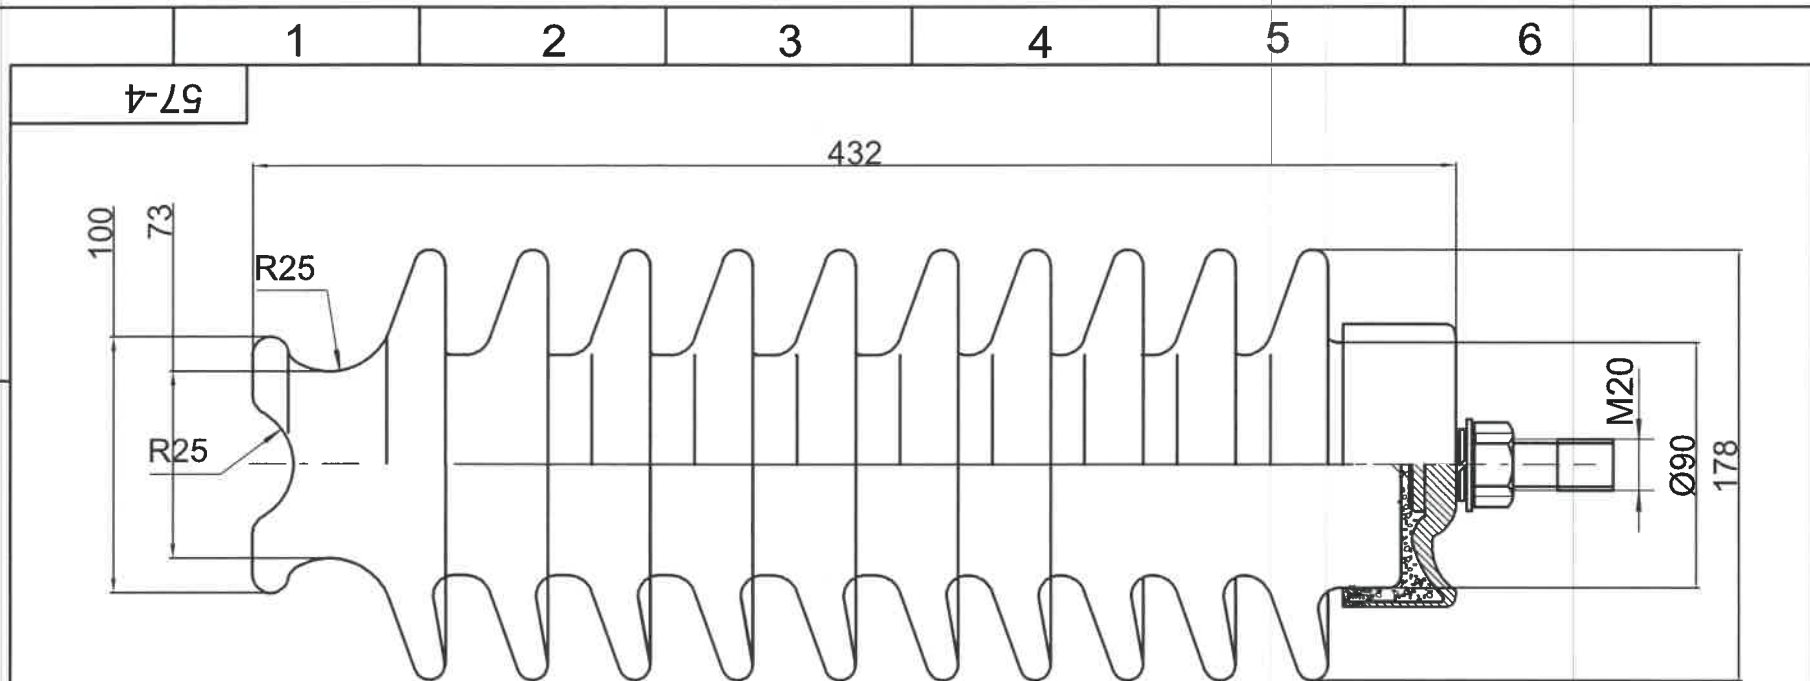


技术要求

- 公称爬电距离: 1015mm;
Nominal Creepage Distance: 1015mm;
- 额定机械破坏负荷: 12.5KN;
Rated Mechanical Breaking Load: 12.5KN
- 低频闪络电压; Dry: 150KV, Wet: 125KV;
Low Frequency Dry Flashover; Dry: 150KV; Wet: 125KV
- 临界冲击闪络电压; 正值: 255KV 负值: 340KV.
Critical Impulse Flash over ; Pose: 255KV, Neg: 340KV.
- 执行标准: Ansi C29.7-1996

Except as show in the diagram, all shall comply with requirements of Ansi C29.7 -1996

			线路柱式绝缘子 Post-type Porcelain Insulator		57-4	
标记Mark	处数Number	签名Signature 日期Date	产品图 Product Image		苏州爱建电瓷有限公司 Suzhou Aijian Electric Porcelain CO., LTD	
设计Design						
校对Drafting	控制文件		阶段标记PhaseMark 重量Weight 比例Scale			
审核Audit						
批准Approval			共 张 第 张		图号	

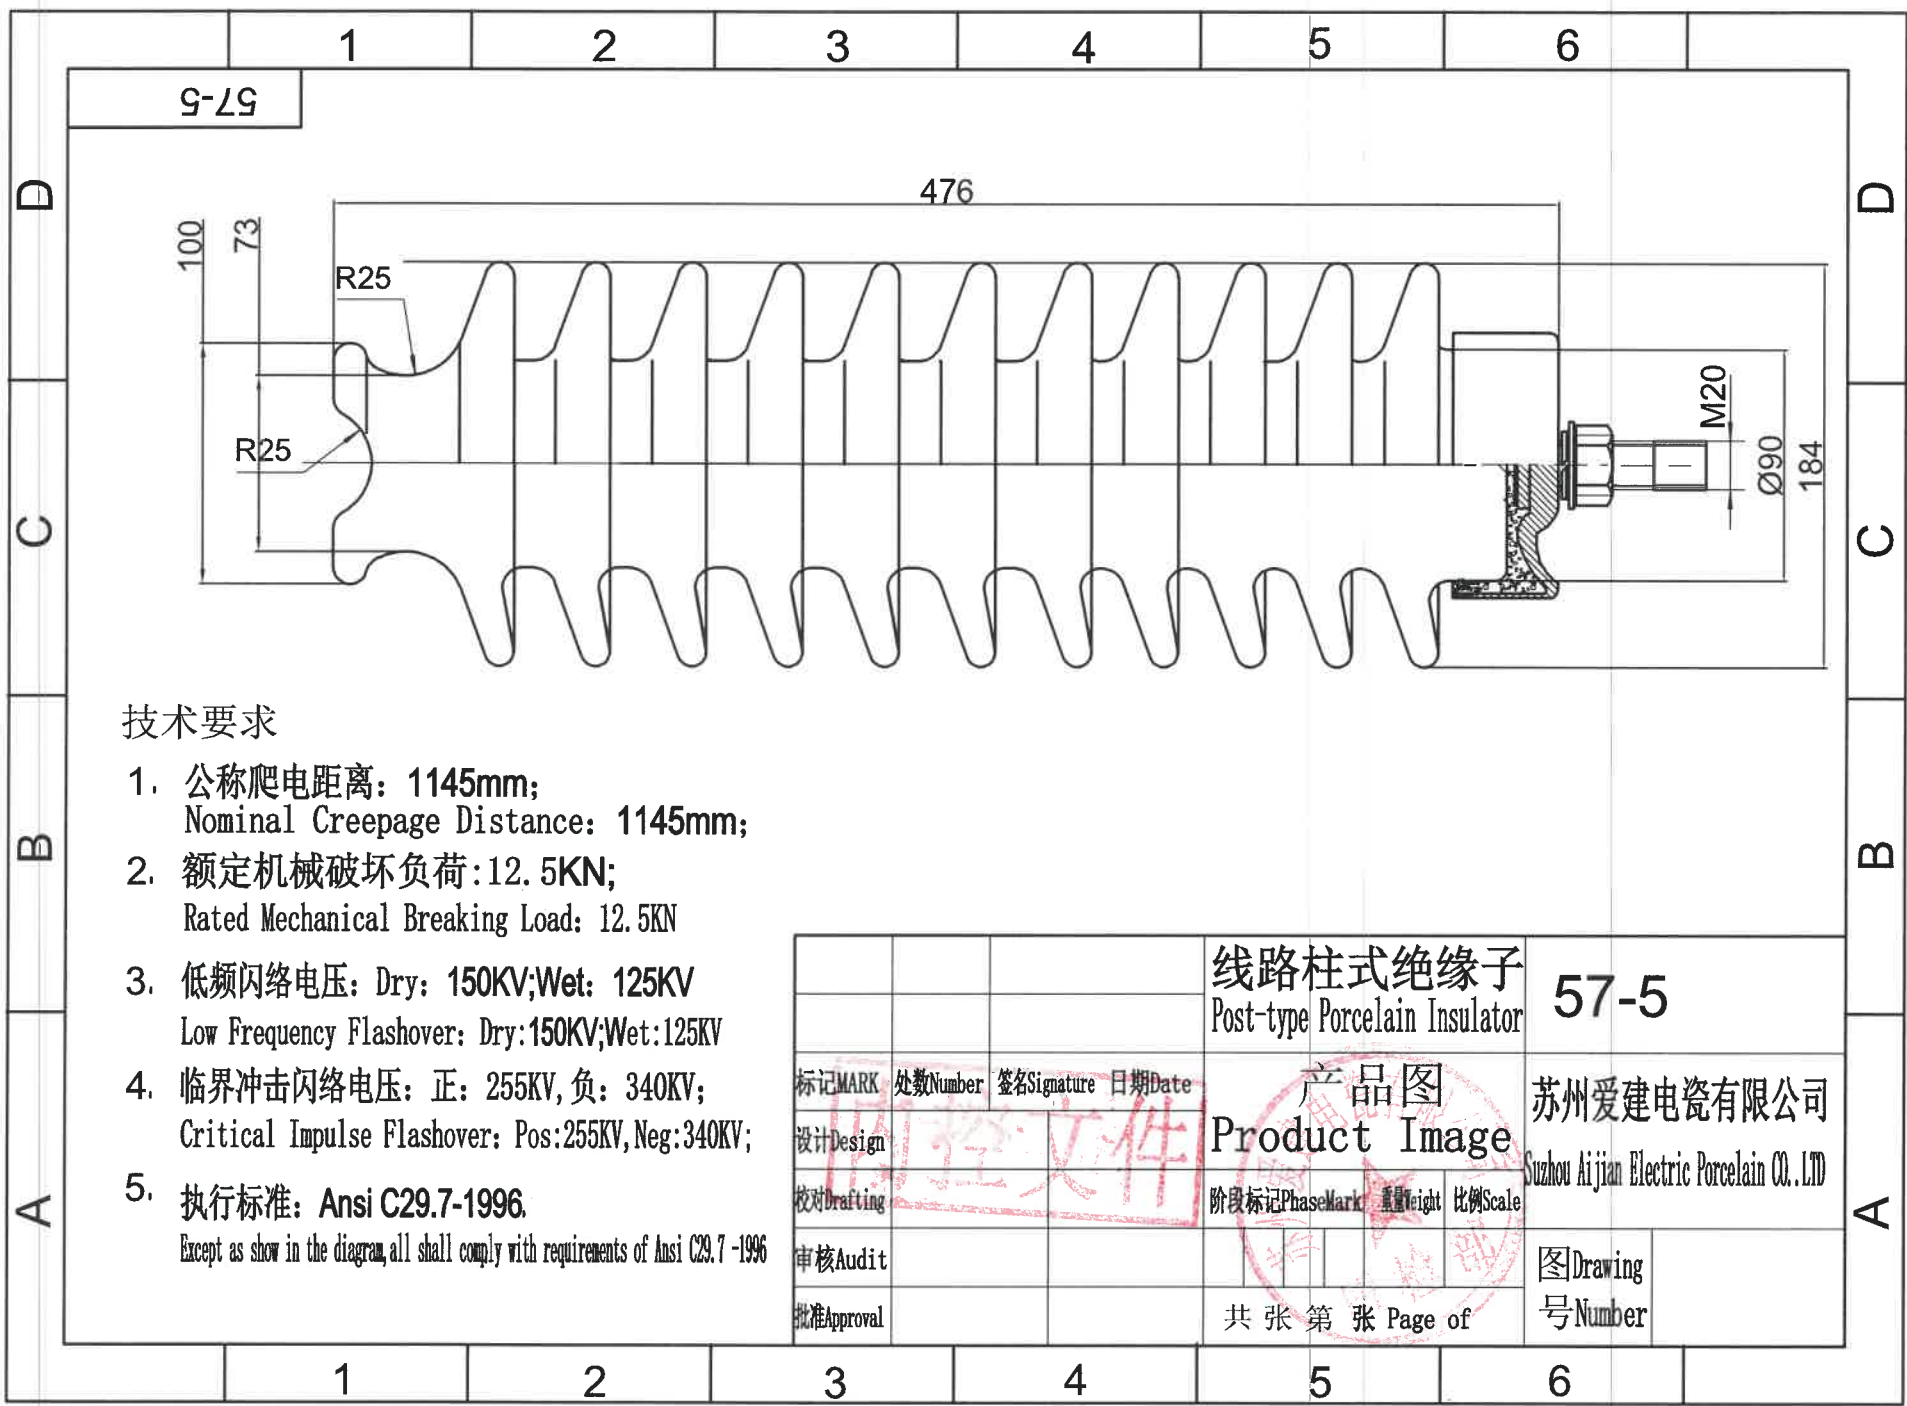

技术要求

- 公称爬电距离: 1145mm;
Nominal Creepage Distance: 1145mm;
- 额定机械破坏负荷: 12.5KN;
Rated Mechanical Breaking Load: 12.5KN
- 低频闪络电压: Dry: 150KV; Wet: 125KV
Low Frequency Flashover: Dry: 150KV; Wet: 125KV
- 临界冲击闪络电压: 正: 255KV, 负: 340KV;
Critical Impulse Flashover: Pos: 255KV, Neg: 340KV;
- 执行标准: Ansi C29.7-1996.
Except as show in the diagram, all shall comply with requirements of Ansi C29.7-1996

			线路柱式绝缘子			57-5
			Post-type Porcelain Insulator			
标记MARK	处数Number	签名Signature	日期Date	产品图		苏州爱建电瓷有限公司 Suzhou Aijian Electric Porcelain CO., LTD
设计Design				Product Image		
校对Drafting				阶段标记PhaseMark		
审核Audit				重量Weight		
批准Approval				比例Scale		图Drawing
				共 张 第 张 Page of		号Number